

Sinus Oscillator Jostikit JK 03

TILSLUTNING
ANSCHLUSS
CONNECTION
RACCORDEMENT




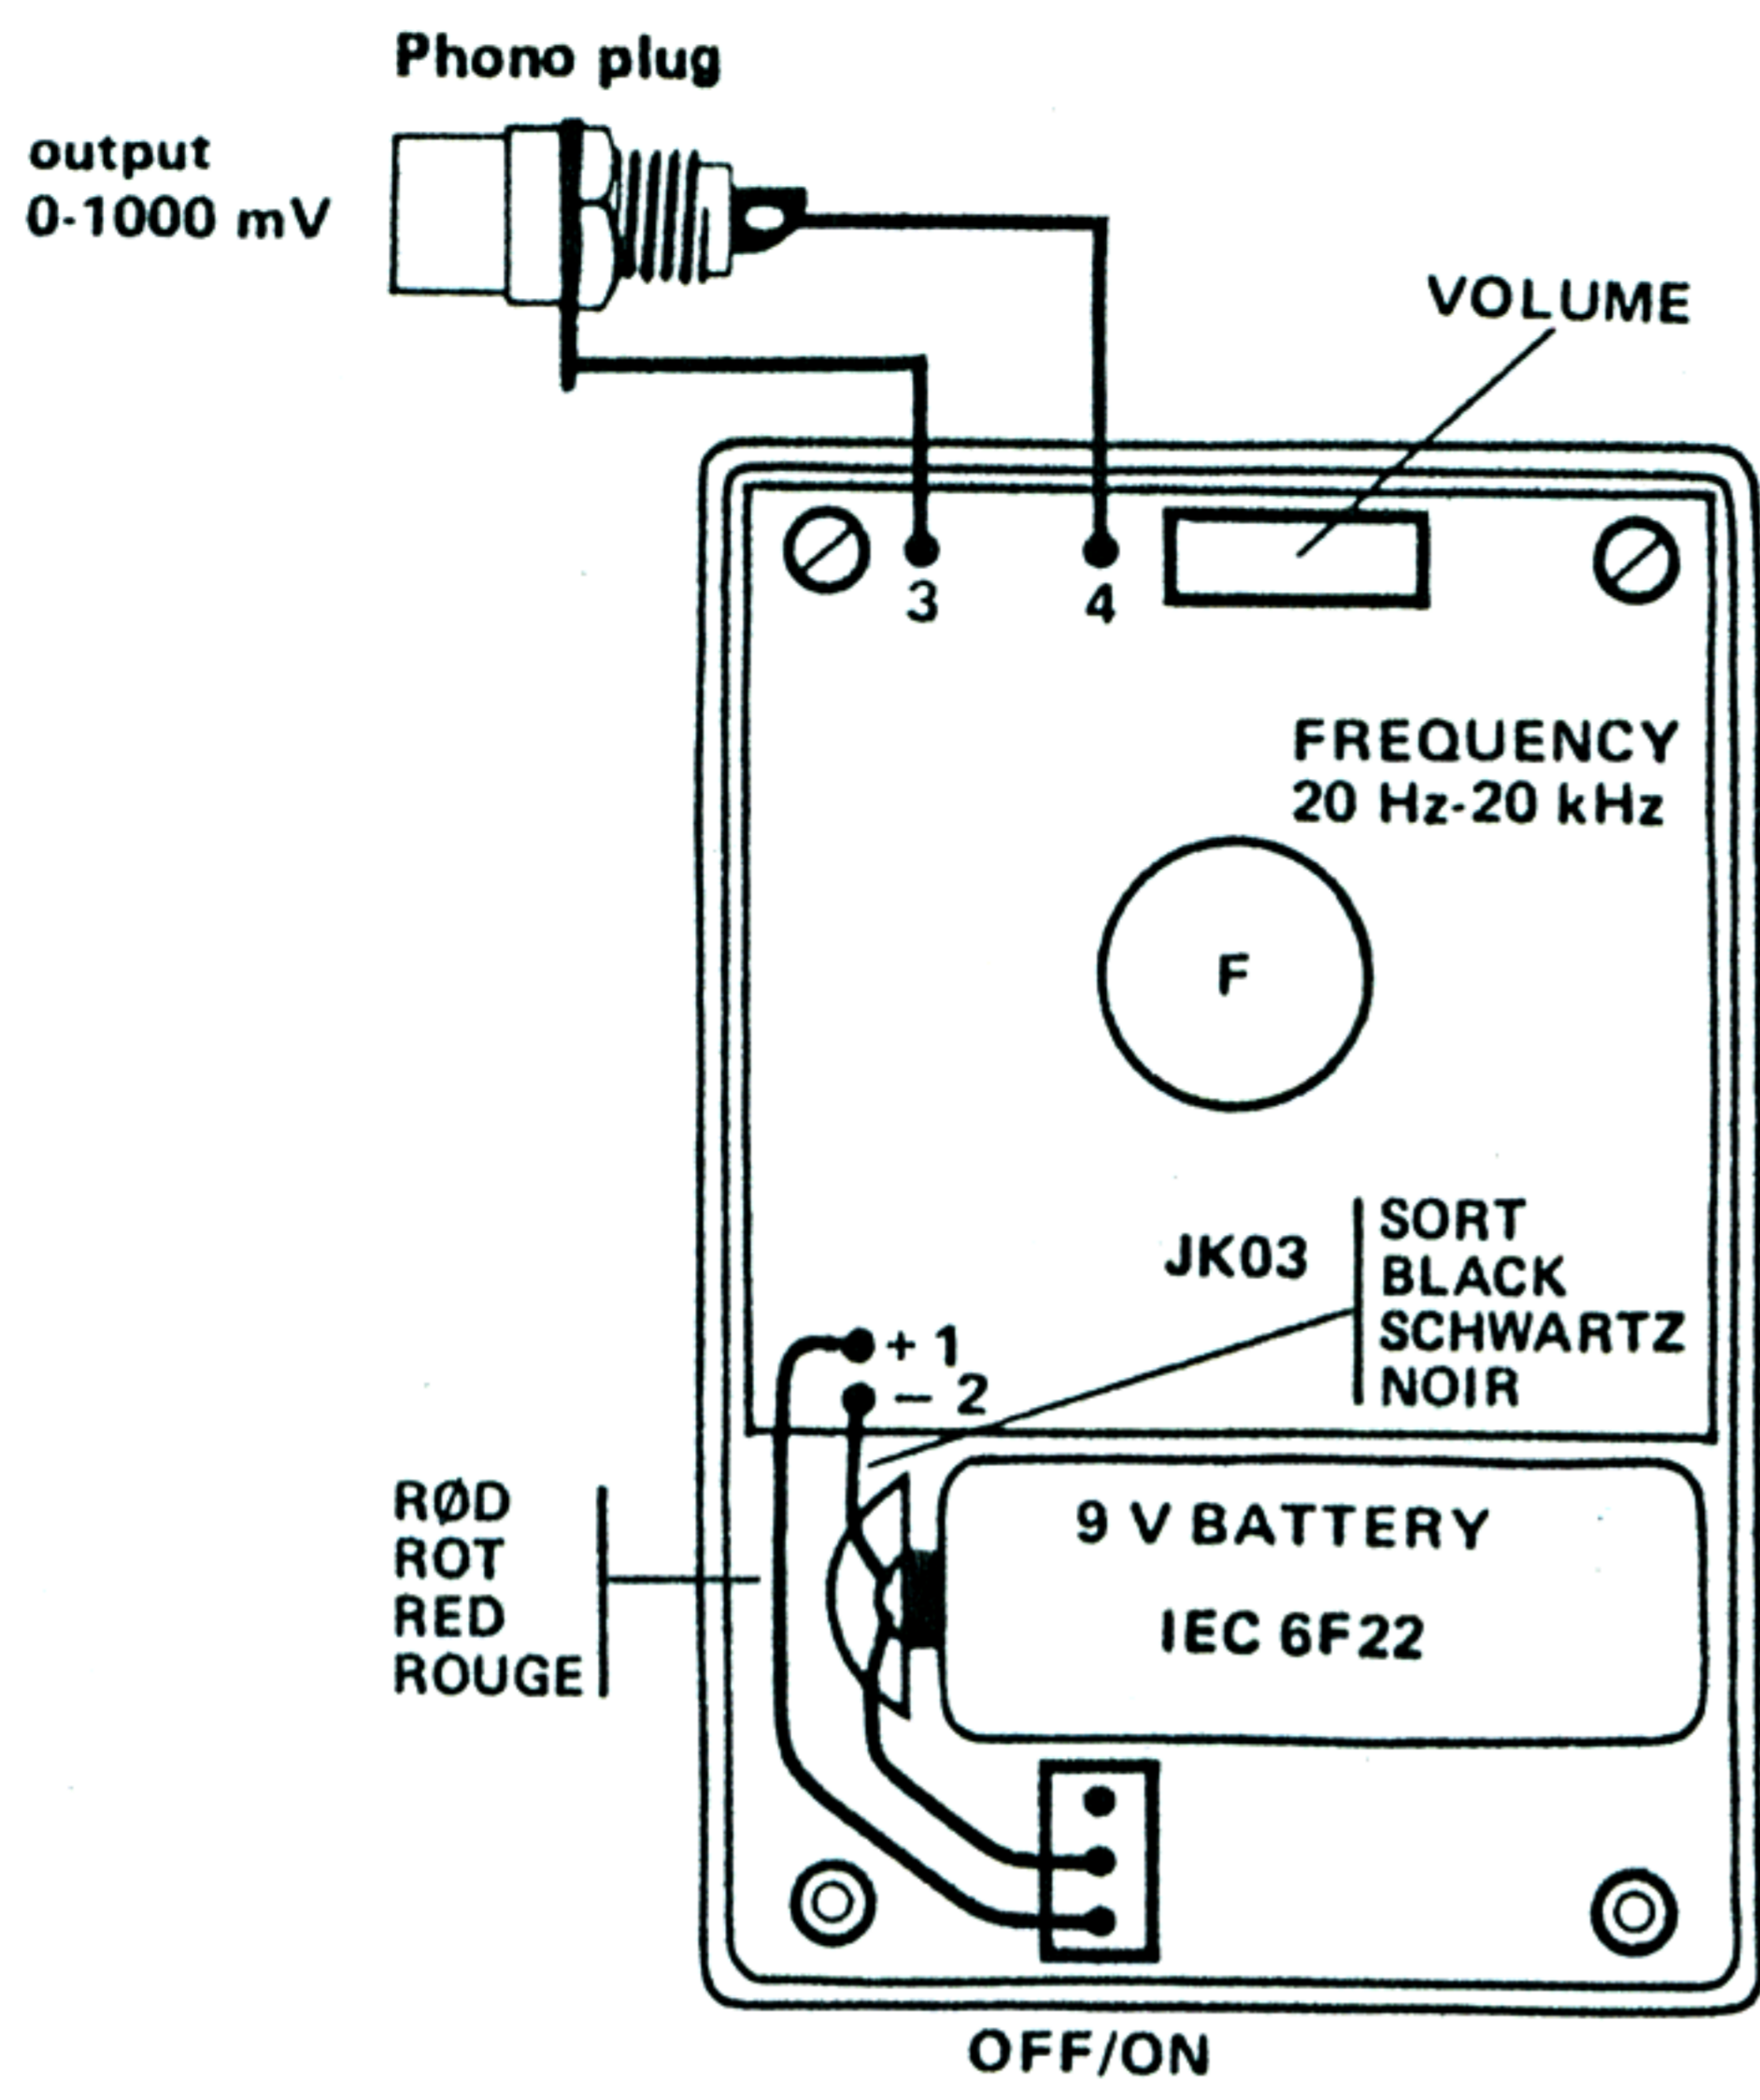


DIAGRAM
SCHALTUNG
DIAGRAM
DIAGRAMME

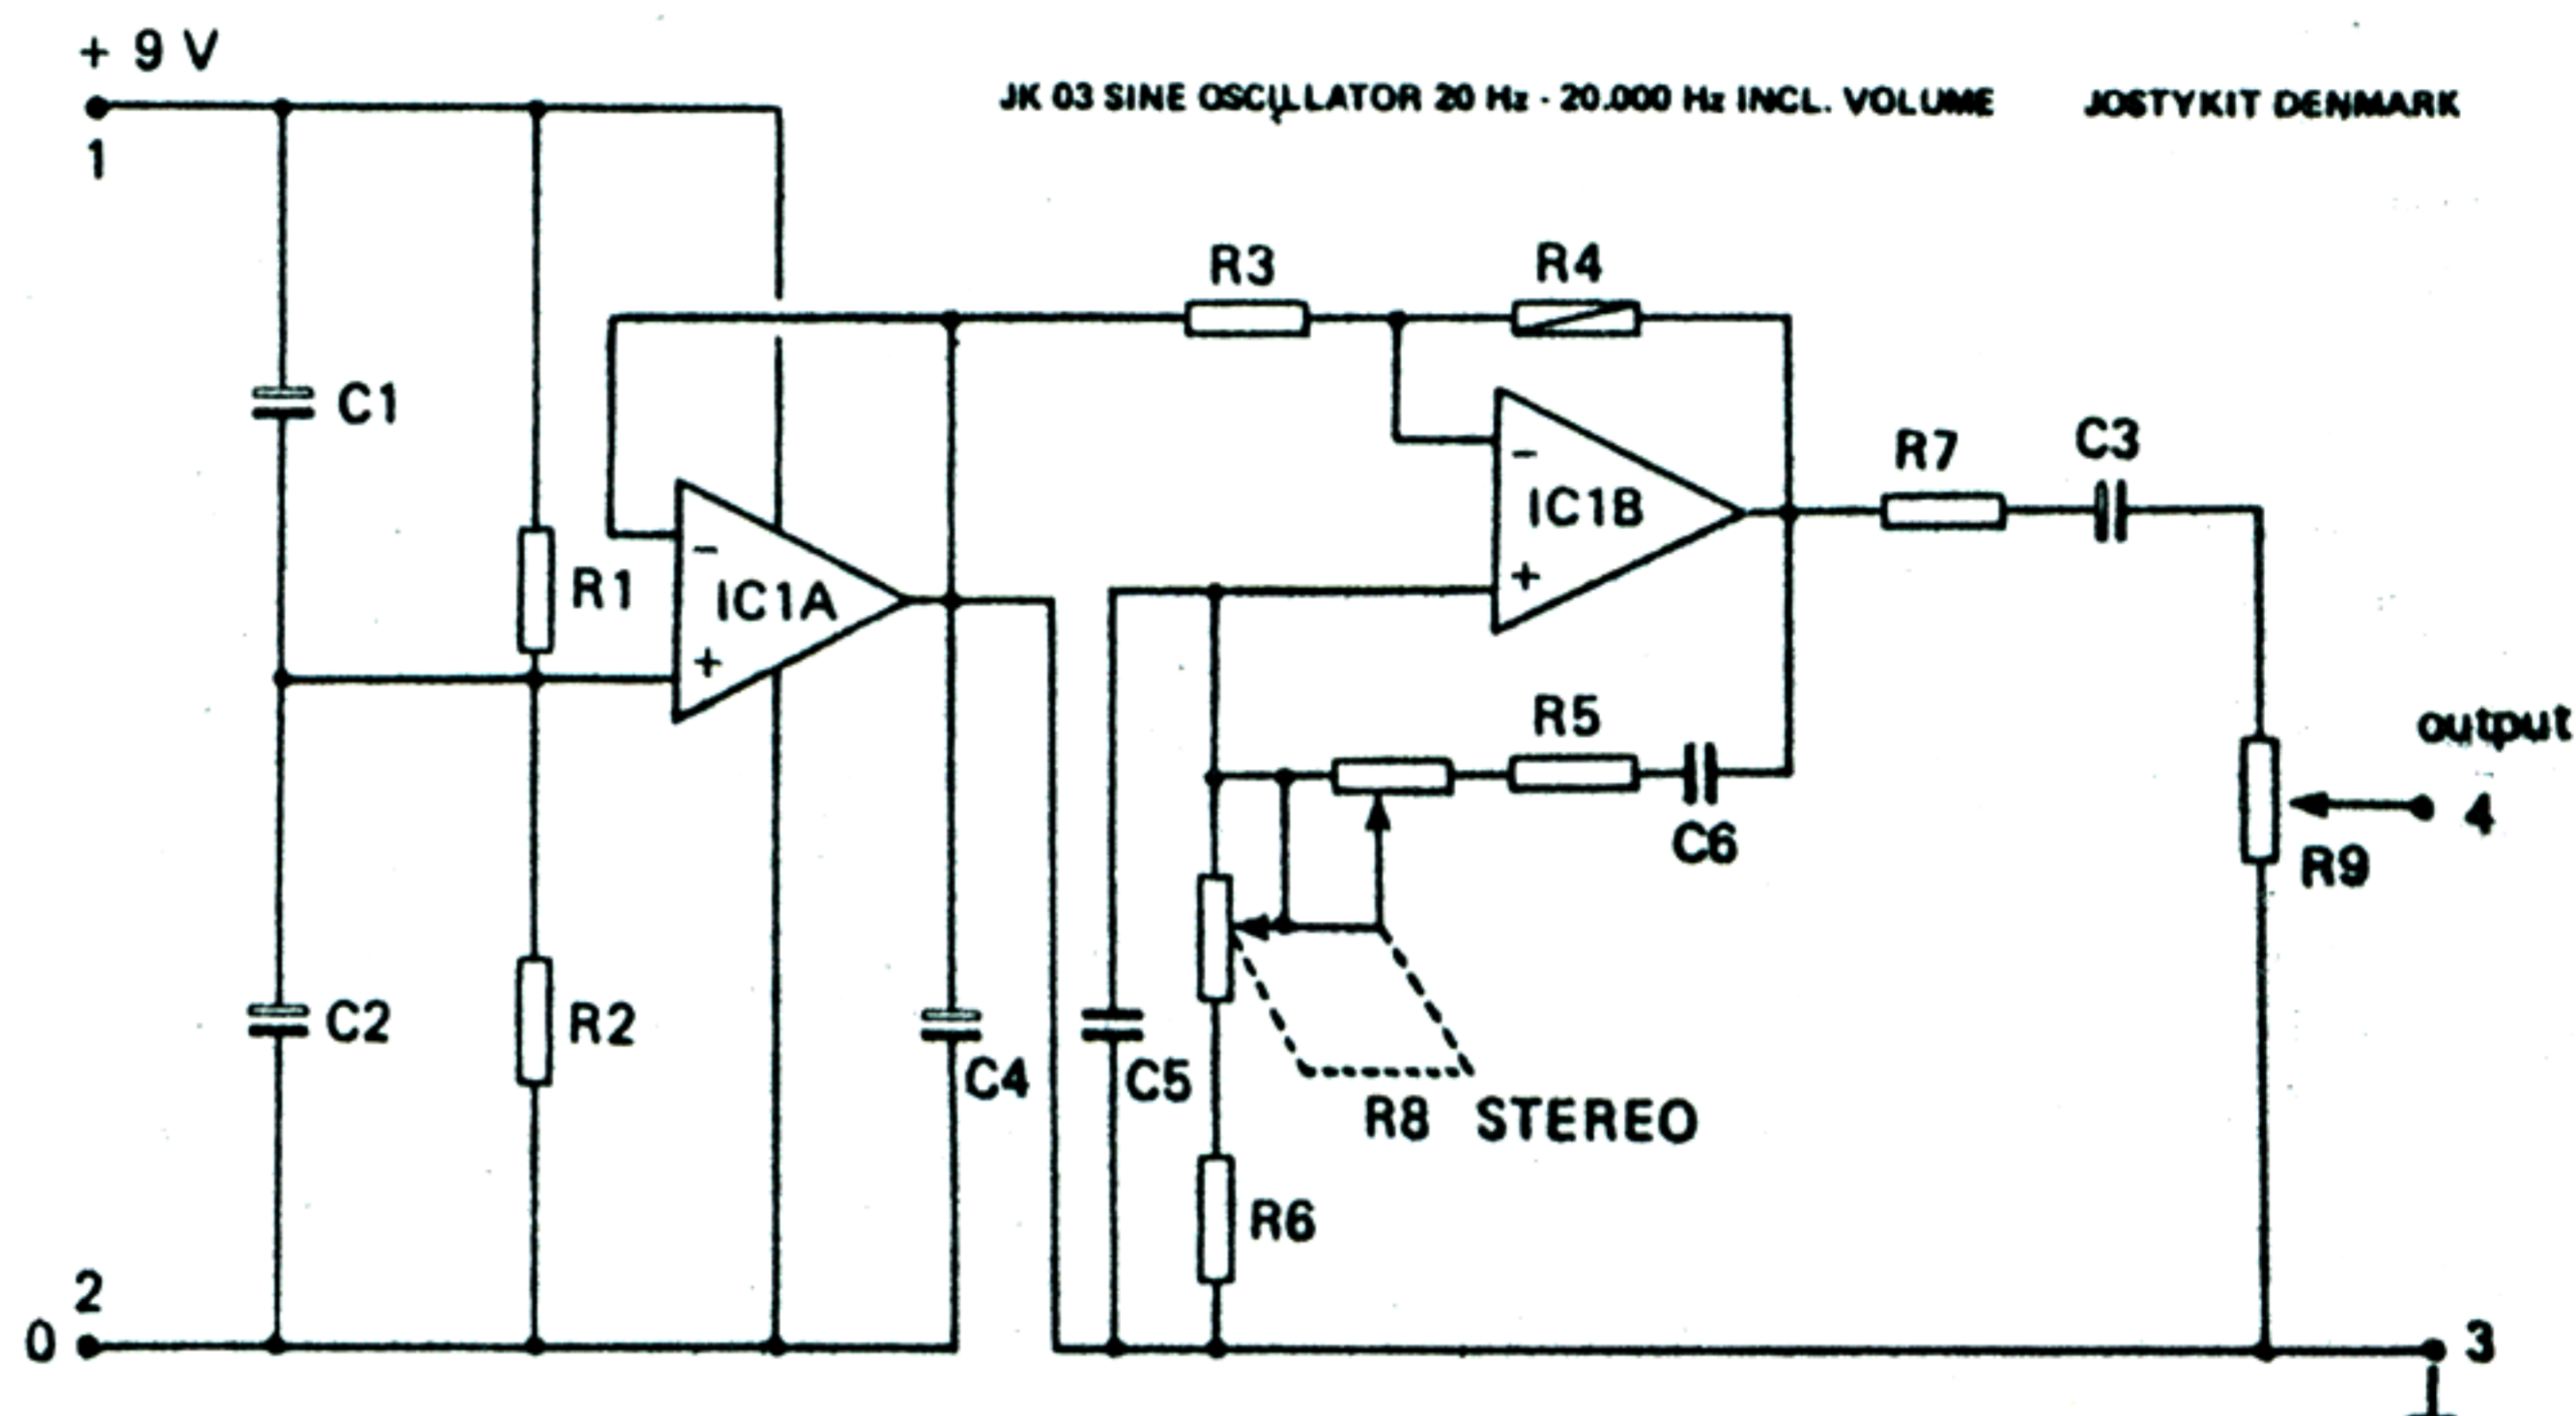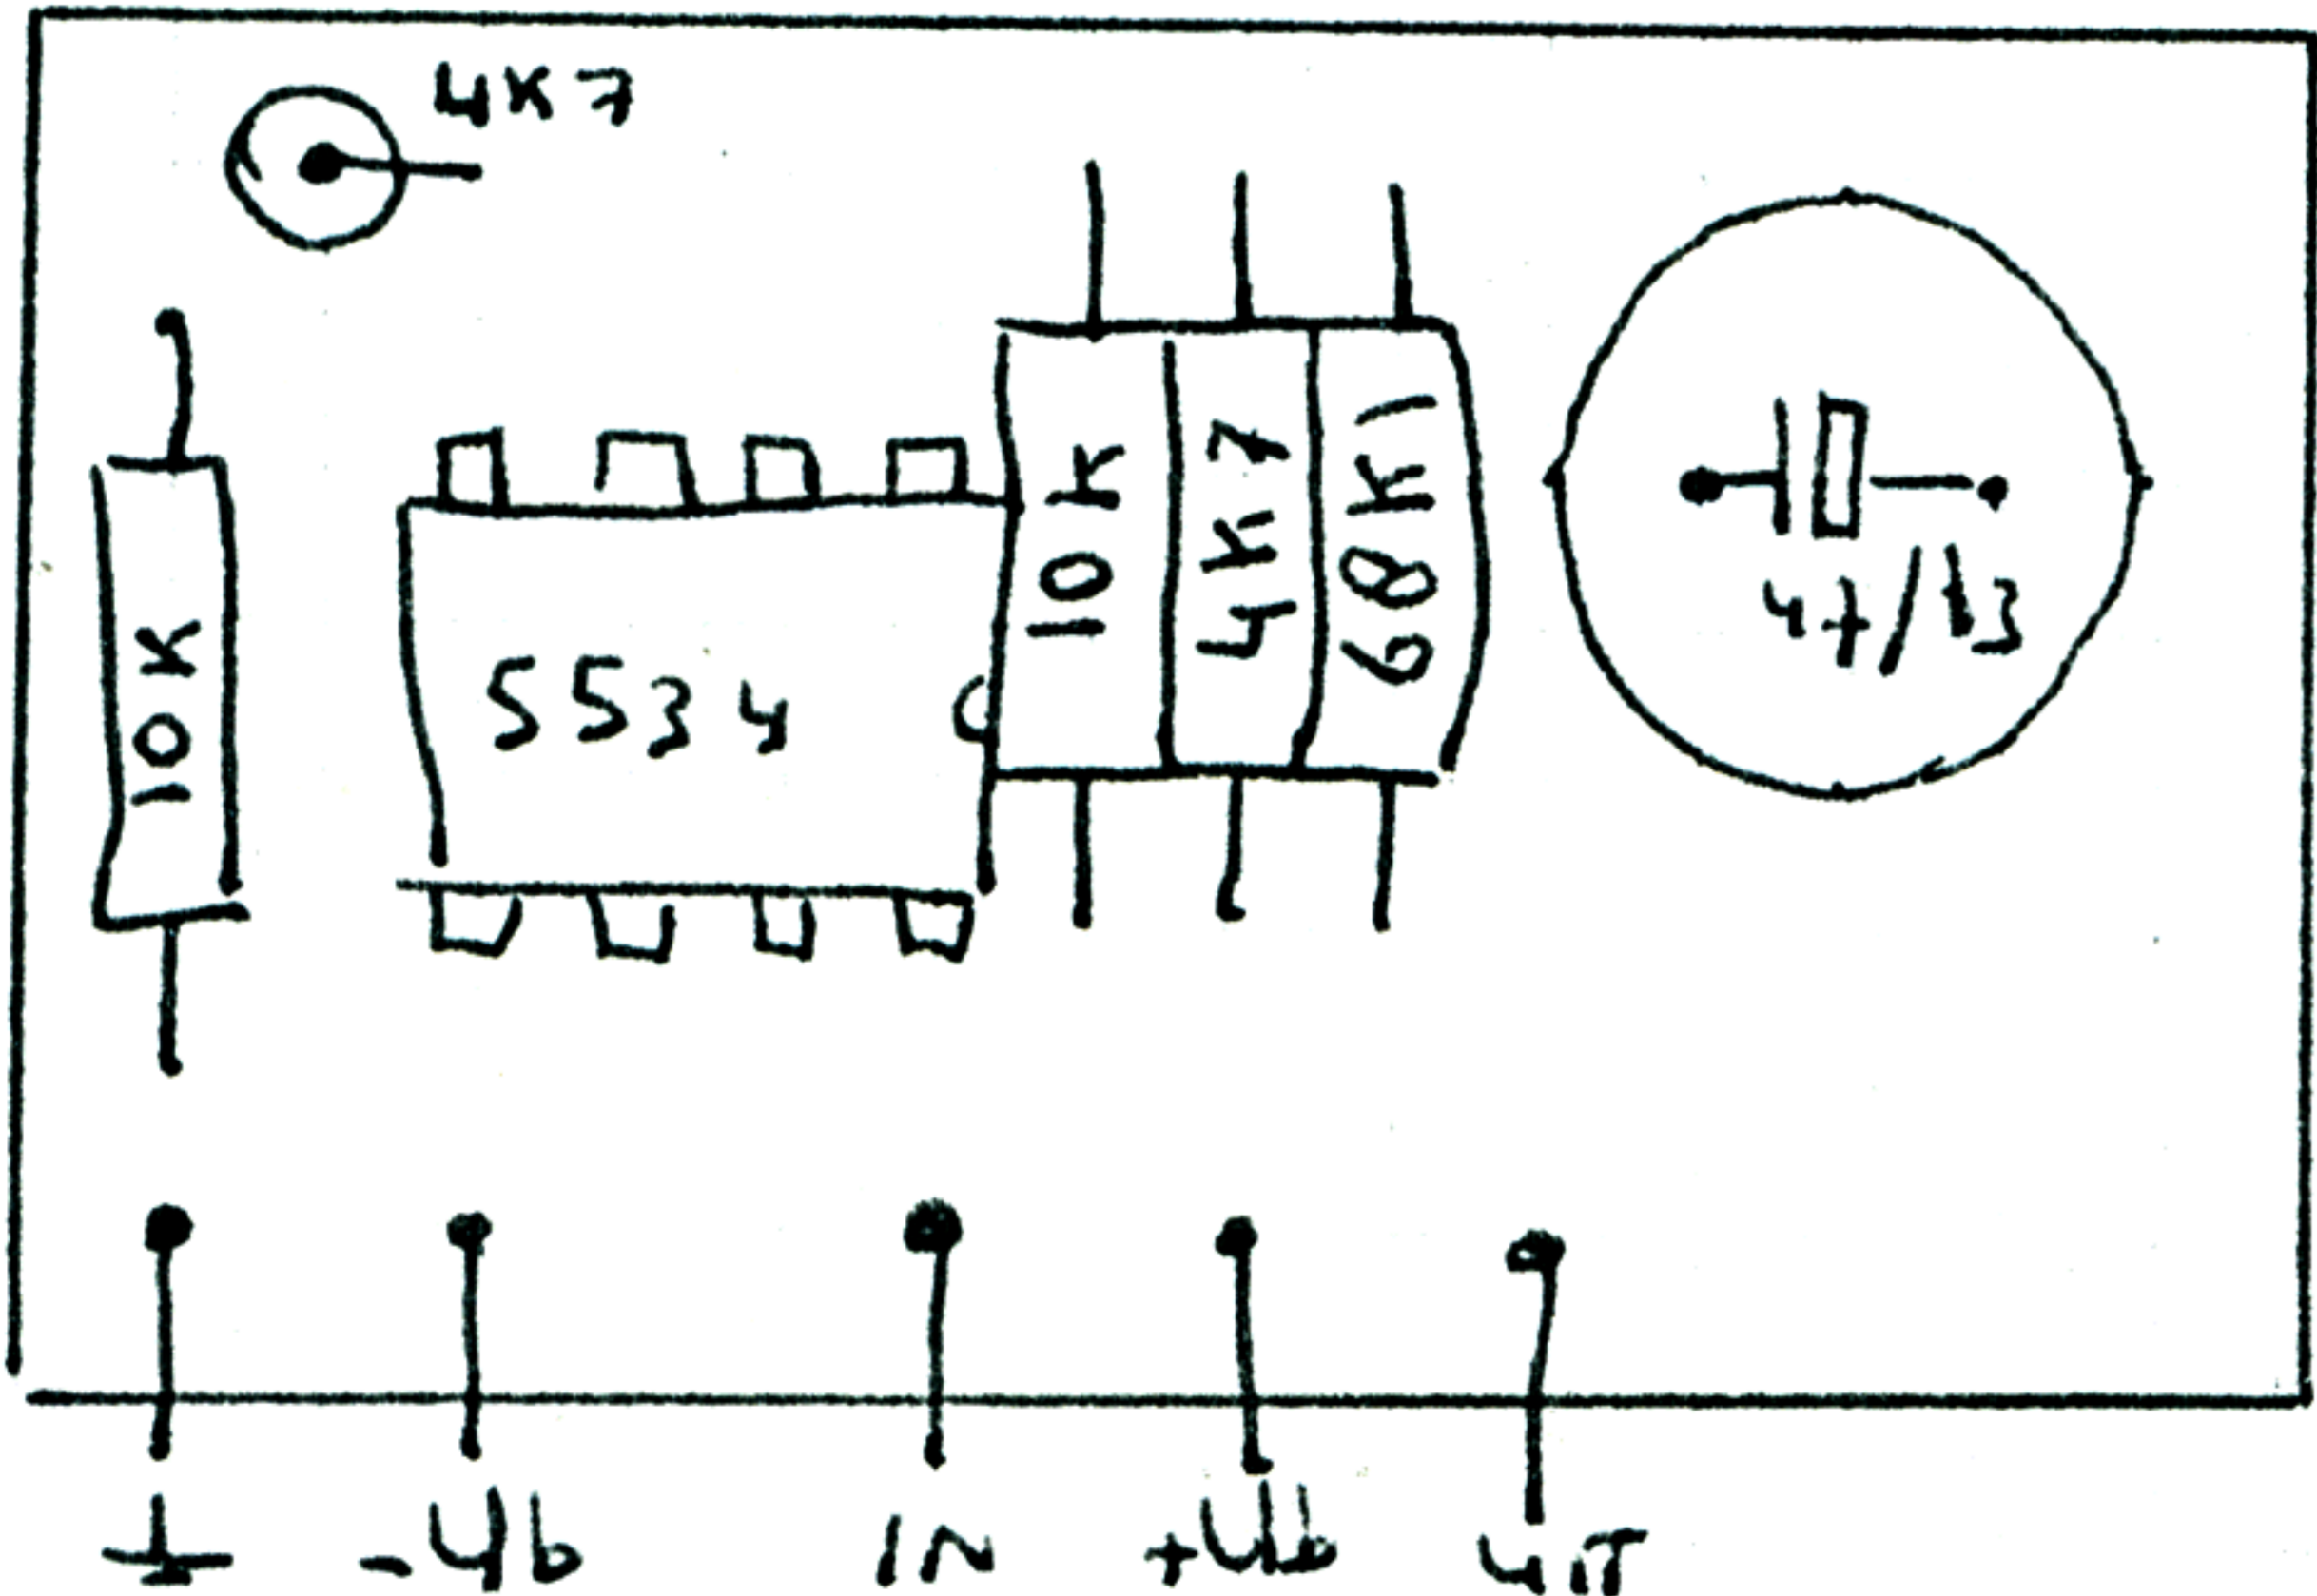

ORIGINALE SCHEMA

$I_{opp} = 4 \text{ mA}$
 $U_{out \text{ max}} = 1 \text{ V}$
 $Z_{out} = 100 \Omega$
 Range = 20 Hz - 20 kHz

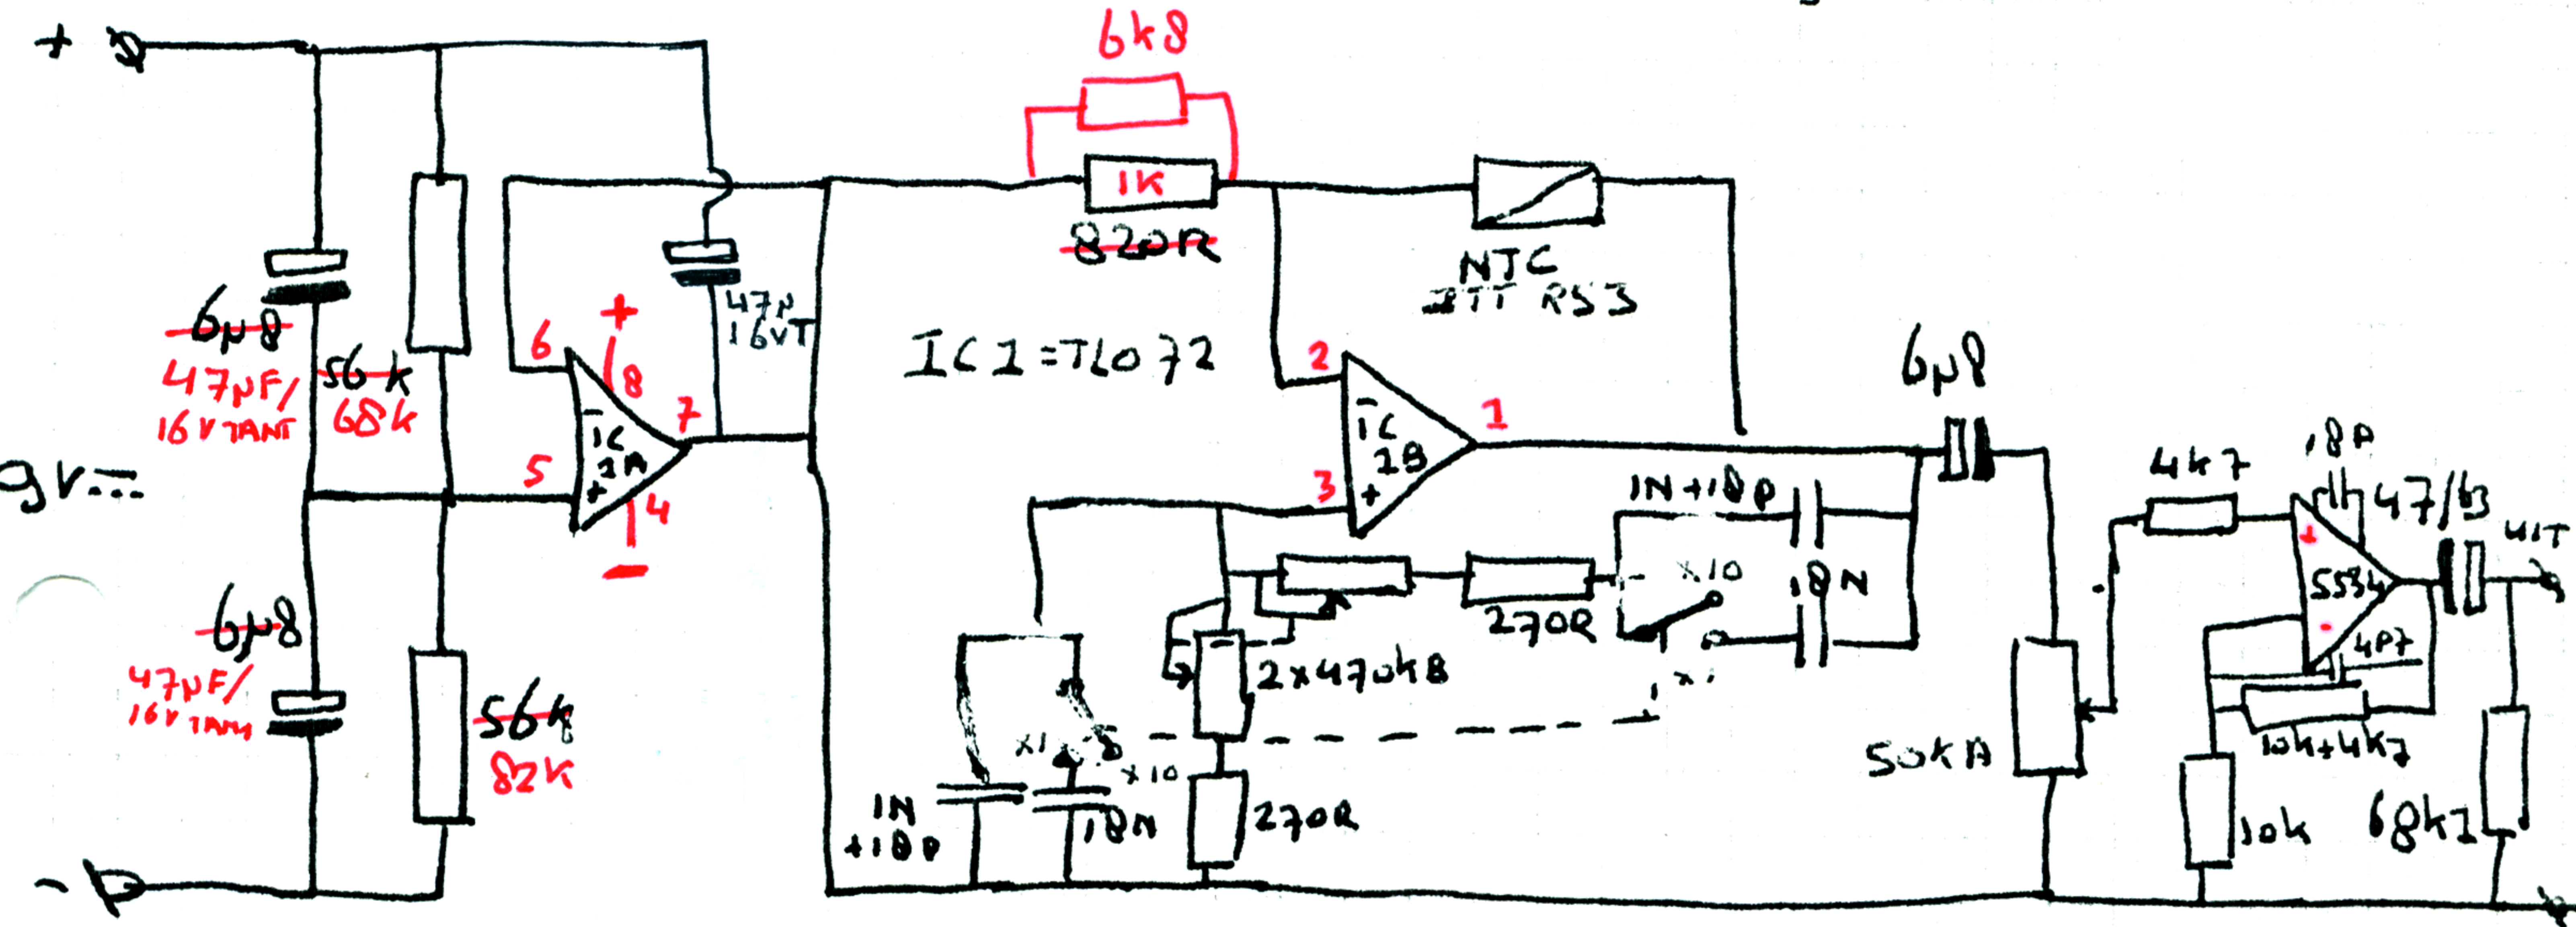

$U_b = 9 \text{ V}$
 $THD(1 \text{ kHz}) = < 0.01\%$
 $Out \text{ max} = +6 \text{ dBV}$
 $I_{opp} = 9 \text{ mA}$
 $Z_{out} = 60 \Omega$
 Range = $\times 1$: 20 Hz - 20 kHz
 $\times 10$: 200 Hz - 200 kHz